

WATER SERVICE DETAIL


NOT TO SCALE

WATER SERVICE NOTES:

1. CONTRACTOR SHALL COMPLY WITH ALL CURRENT CITY OF BINGHAMTON WATER DEPARTMENT POLICIES FOR RECONNECTION OF EXISTING WATER SERVICES.
2. WATER SERVICE EXCAVATION MAY NEED TO BE LEFT OPEN AND GUARDED, OR PLATED, UNTIL WATER METERS ARE CHECKED AND SERVICES TESTED UNDER PRESSURE BY THE WATER DEPARTMENT.
3. IF OTHER UTILITIES ARE ENCOUNTERED DURING THE INSTALLATION OF THE WATER SERVICE THAT WILL AFFECT THE MINIMUM COVER, THEN THE CONTRACTOR IS TO NOTIFY THE INSPECTOR. THE WATER SERVICE SHALL BE INSTALLED UNDER THE UTILITY TO MAINTAIN MINIMUM COVER UNLESS OTHERWISE AUTHORIZED BY ENGINEER.
4. 100% NEW COMPACTABLE FILL FROM 12" BEHIND SIDEWALK TO MAIN.

ITEM 5 - TRENCH EXCAVATION

IN UNPAVED AREAS, TOP LIMIT FOR NEW COMPACTABLE FILL SHALL BE 6" BELOW EXISTING GROUND. THE TOP 6" SHALL BE APPROVED TOPSOIL AND SEEDING [ITEMS 121A & 123]

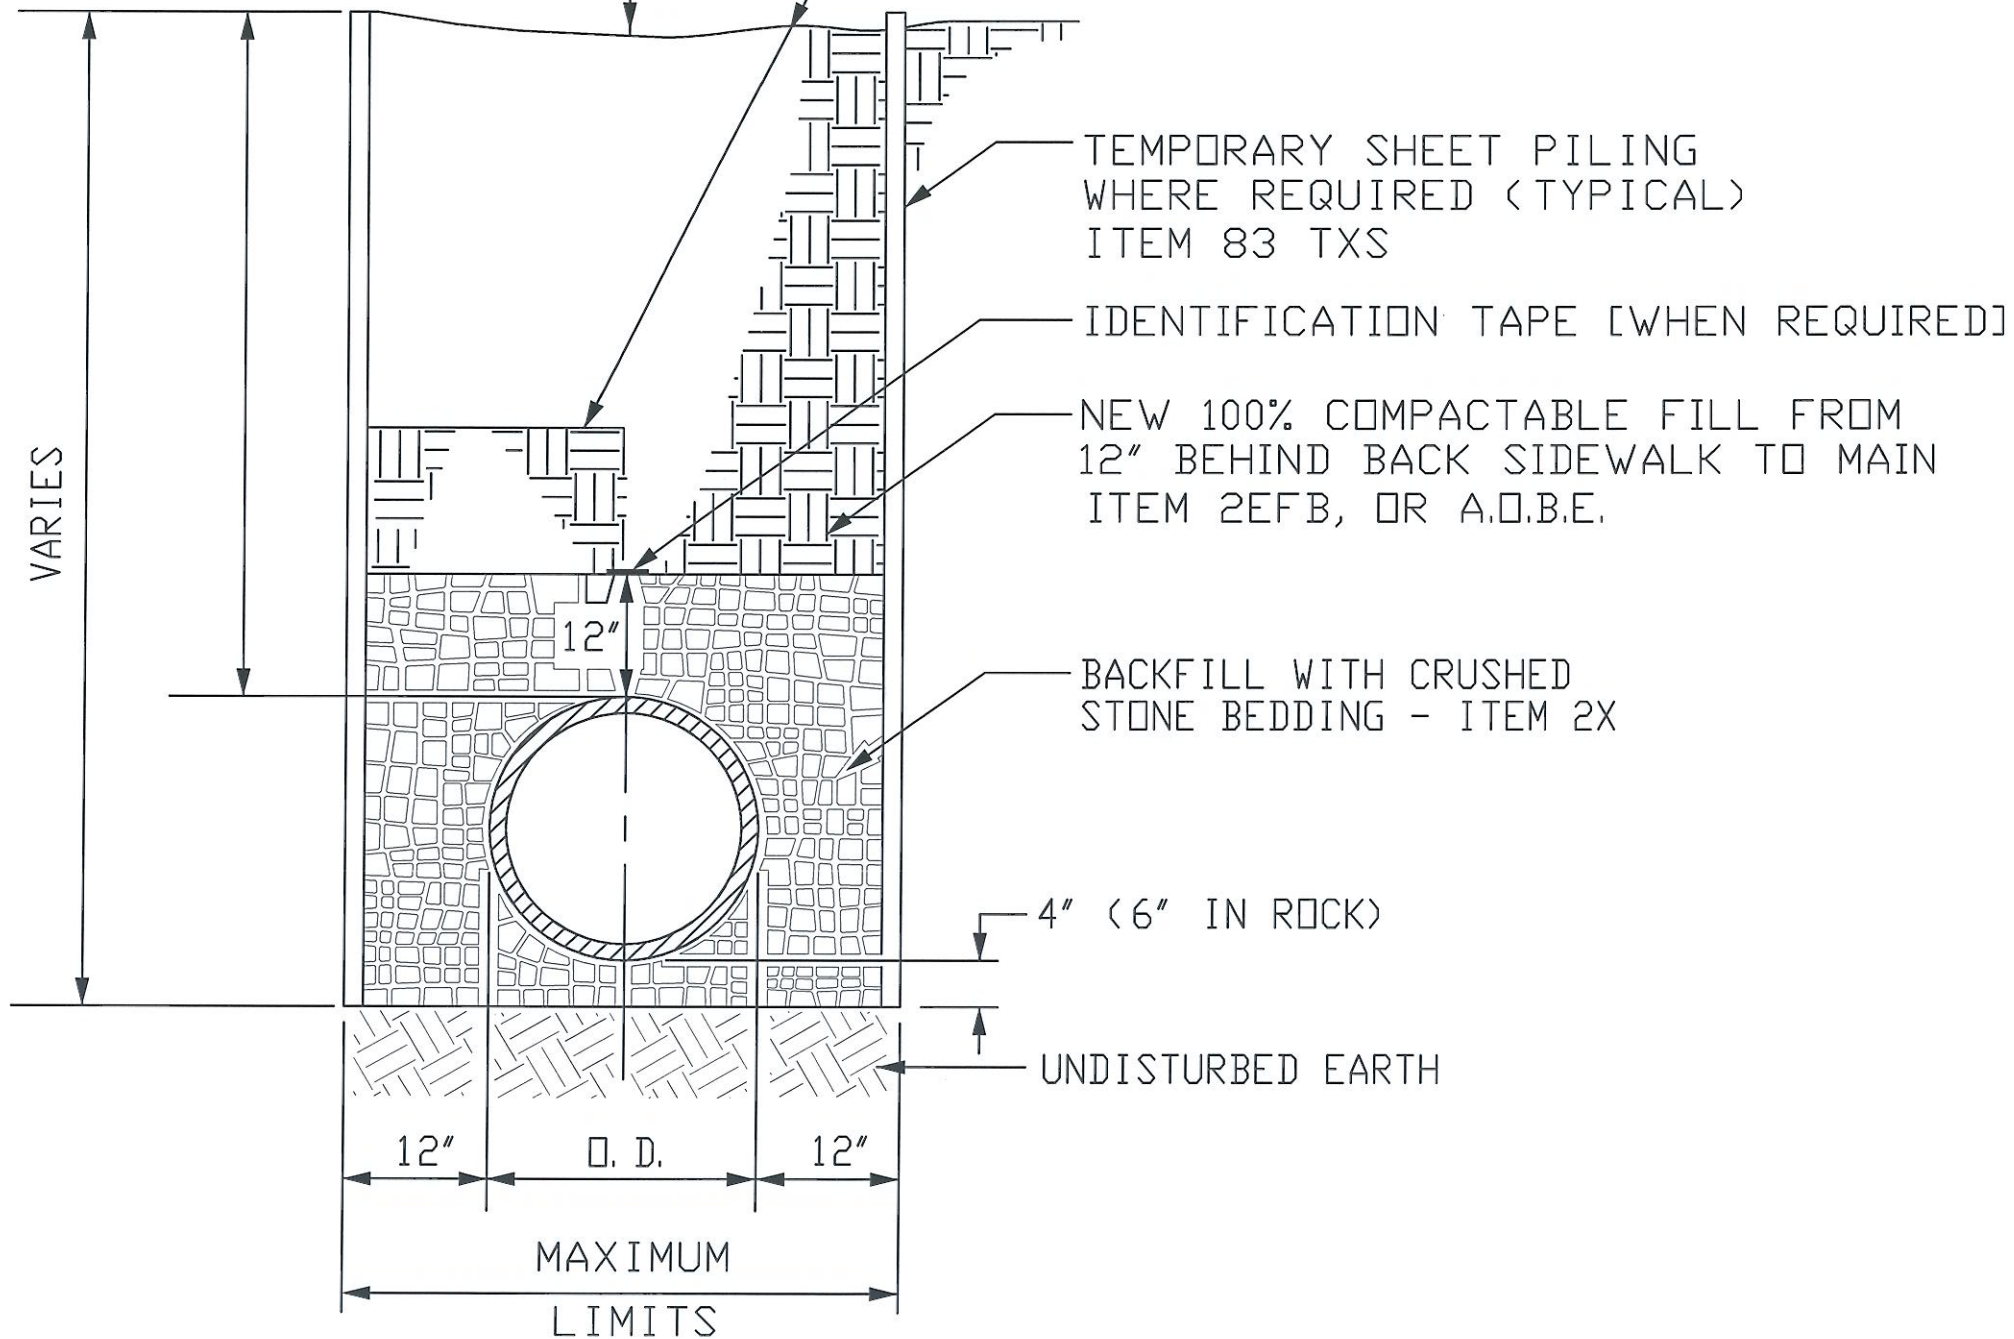

DETAIL
EXCAVATION AND BACKFILL
FOR PIPES UNDER 24" DIA.
NOT UNDER PAVEMENT

NOT TO SCALE